

CAULKED JOINT BY OTHERS  
TURNED DOWN FULL VERTICAL  
FACE OF COPING STONE

**NOTE:**  
THIS DETAIL MAY BE USED WHEN ALT R230  
THIXO FLASHING CAN NOT BE TURNED DOWN  
THE VERTICAL COPING FACE. JOINT SEALANT  
BY OTHERS IS CONSIDERED A MAINTENANCE  
ITEM EXCLUDED FROM WARRANTY.

ANY ACCEPTABLE  
VERTICAL JOINT  
FLASHING

ALT R230 THIXO MEMBRANE  
FLASHING ENDED @ OUTSIDE  
HORIZONTAL COPING EDGE

ALT R230 FIELD  
MEMBRANE

ALT R230 THIXO MEMBRANE  
PARAPET FLASHING - SEE  
TYPICAL DETAILS

VIEW @ PARAPET WALL

EXISTING WALL PANEL  
JOINT OPENING


ACCEPTABLE CONTINUOUS JOINT SEALANT  
REMOVE & REPLACE AS REQ'D. (BY OTHERS)

(2) PLY STEPPED ALT R230 THIXO MEMBRANE  
JOINT FLASHING APPLIED CONTINUOUSLY  
CENTERED OVER DE-BOND TAPE & JOINT (TYP.)

ALT R230 THIXO MEMBRANE BASE FLASHING  
LAPPED ONTO JOINT FLASHING BOTH  
SIDES OF JOINT (TYP.)

4" (10 cm)  
(MIN.)

2" (5 cm)  
(MIN.)

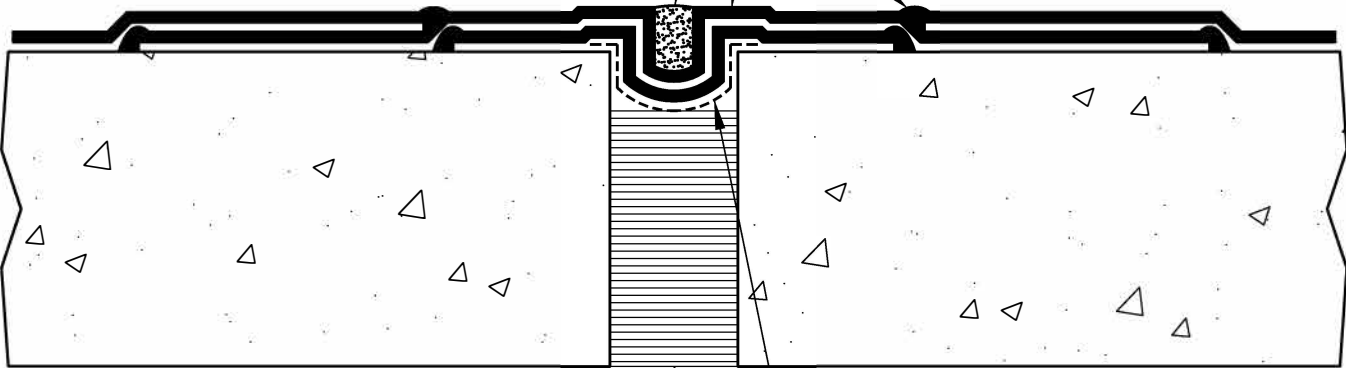

**NOTE:**  
SIZE WIDTH OF DE-BONDING TAPE TO PROVIDE  
UN-ADHERED AREA MINIMUM 5 TIMES LARGER  
THAN THE MAXIMUM ANTICIPATED EXPANSION.  
MEMBRANE COVER STRIP MUST EXTEND PAST  
DE-BONDING TAPE 4" MINIMUM ALL SIDES (TYP.)

DE-BONDING TAPE SIZED TO ACCOMMODATE  
MOVEMENT & CENTERED OVER JOINT.

PREFORMED COMPRESSIBLE FILLER OR  
BACKER ROD SIZED FOR OPENING.

SECTION THRU JOINT

SCALE: NTS



**COPING CAP CAULKED JOINT FLASHING**

DRAWING NO.:

**J-3D**

REVISION  
0

ISSUE DATE  
10-15-2014

SCALE  
N.T.S.

DRAWN BY  
ALT Global

AJ\_03C